


LEAD AND COPPER SAMPLING LOCATIONS – SCMA POTTSVILLE SYSTEM

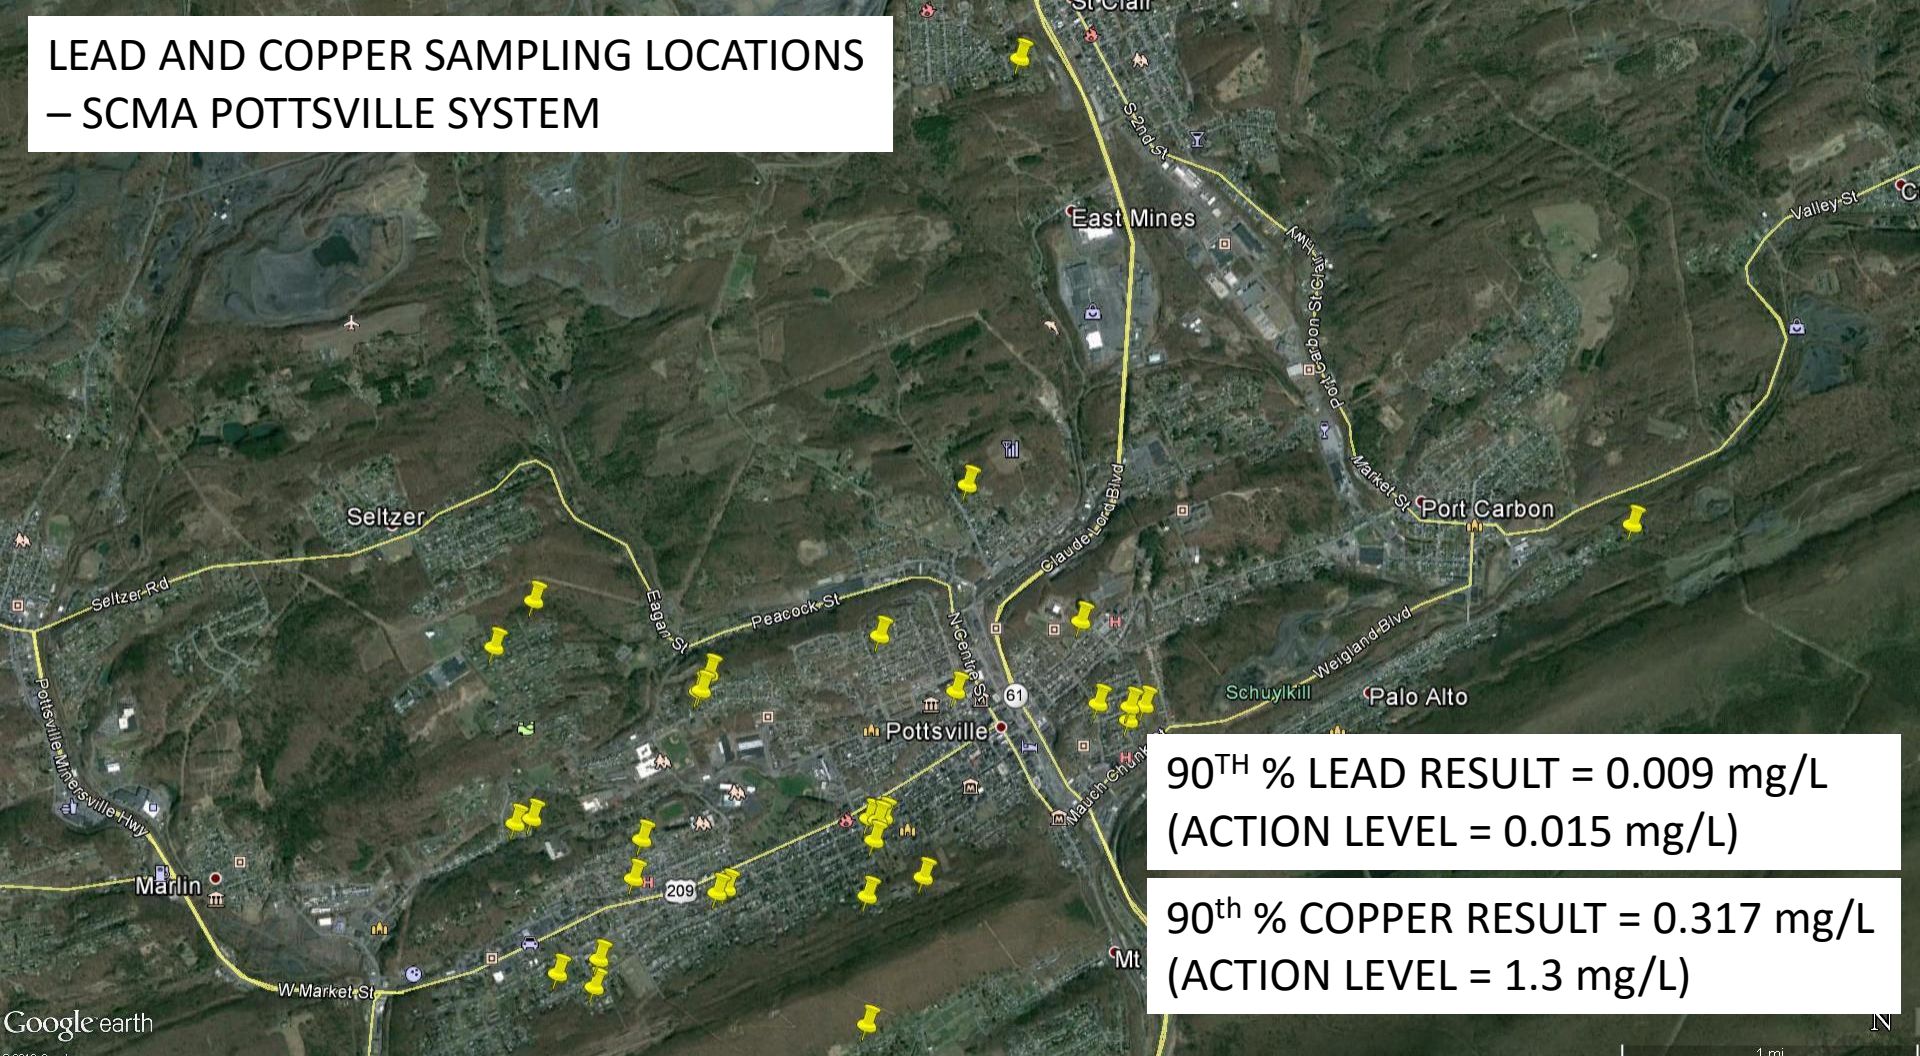

90TH % LEAD RESULT = 0.009 mg/L
(ACTION LEVEL = 0.015 mg/L)

90TH % COPPER RESULT = 0.317 mg/L
(ACTION LEVEL = 1.3 mg/L)