


LEAD AND COPPER SAMPLING LOCATIONS – SCMA PINEBROOK SYSTEM

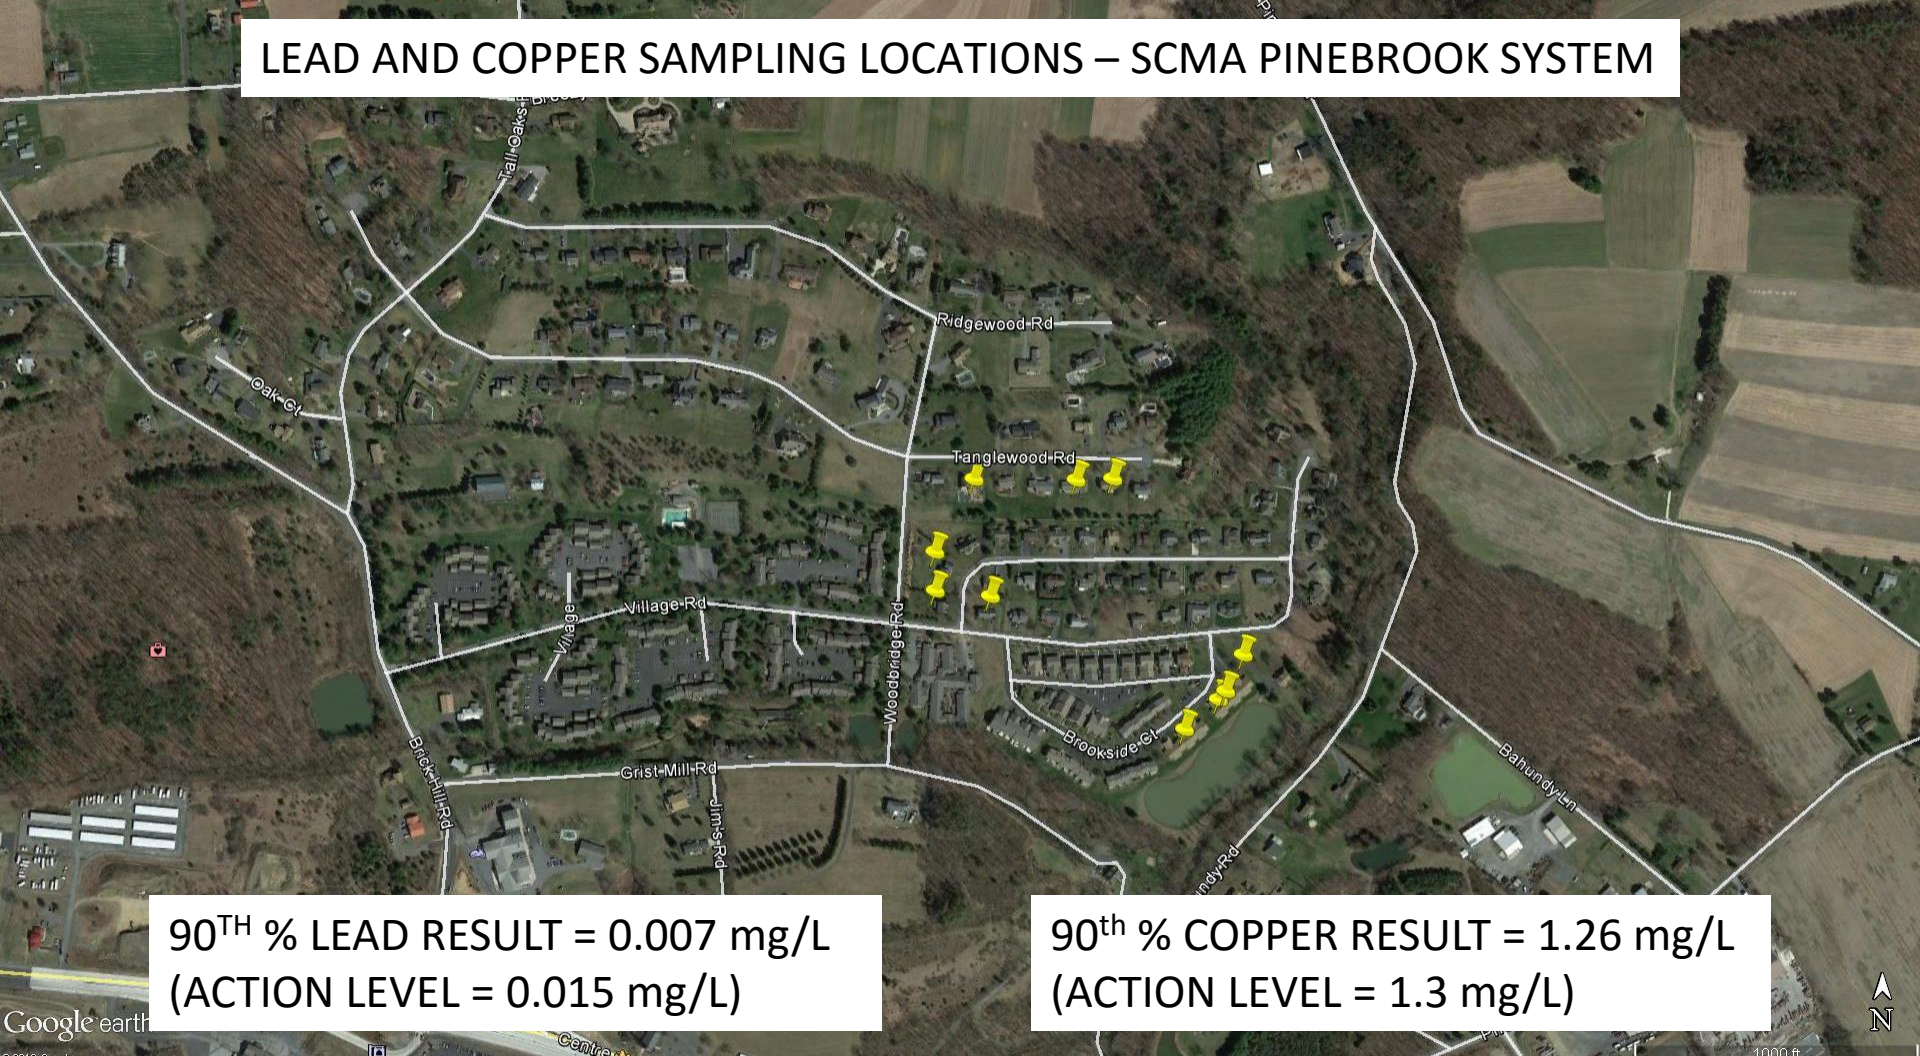

90TH % LEAD RESULT = 0.007 mg/L
(ACTION LEVEL = 0.015 mg/L)

90th % COPPER RESULT = 1.26 mg/L
(ACTION LEVEL = 1.3 mg/L)