


# WATER METER INSTALLATION

REMOTE METER: LOCATE AT SAME HEIGHT AND LOCATION AS ELECTRIC METER

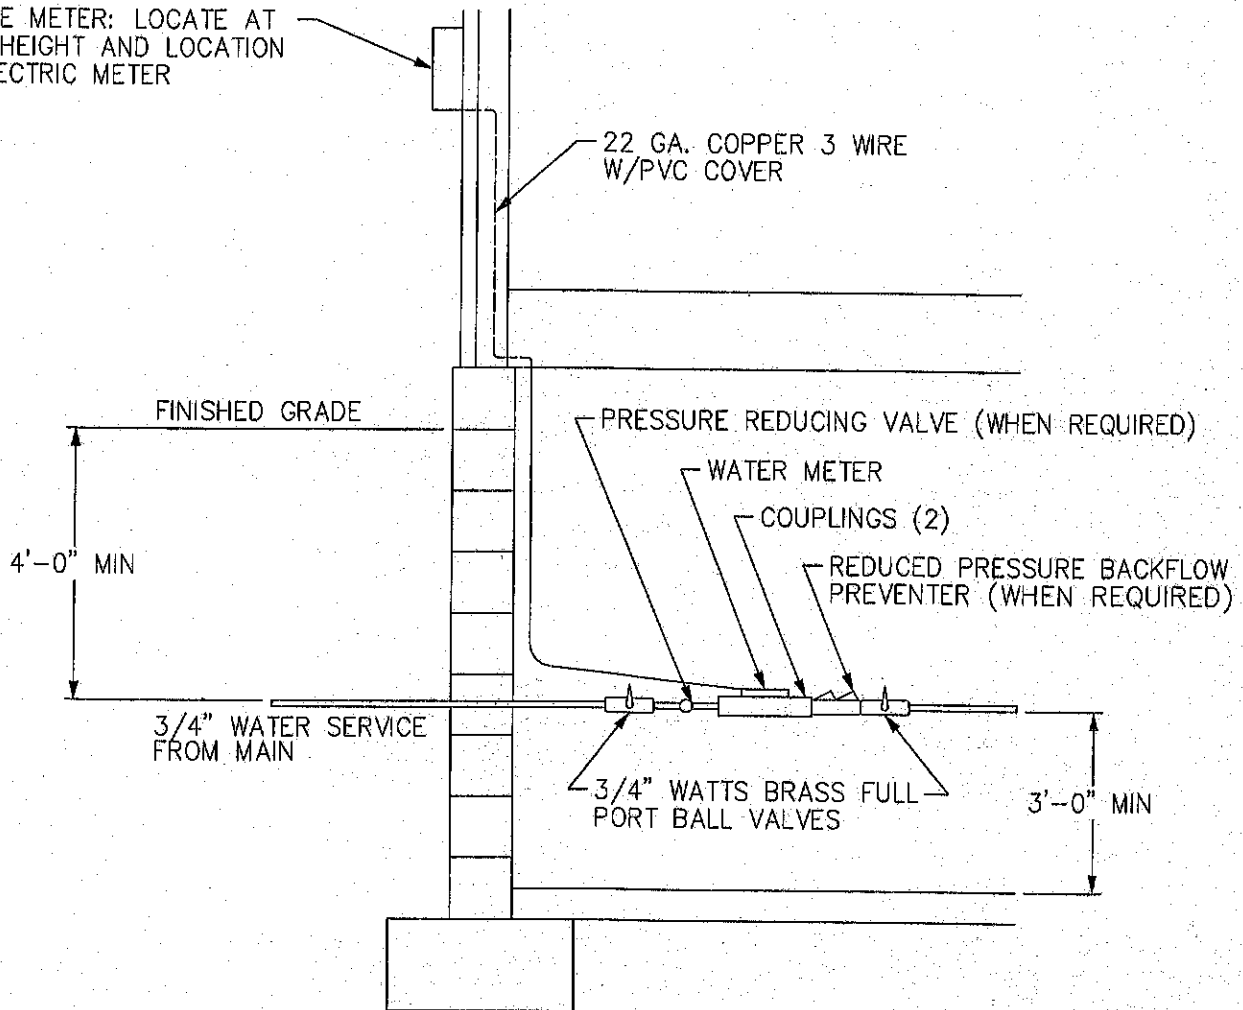

**NOTES:**

1. NO TAPS OR CONNECTIONS PRIOR TO THE WATER METER.
2. MAXIMUM LENGTH OF SERVICE PRIOR TO METER IS 100 FT.
3. SUPPORT METER TO PREVENT STRESS ON SERVICE LINE.
4. DO NOT USE WATER LINE FOR ELECTRICAL SYSTEM GROUNDING.
5. POSITION METER HORIZONTAL.
6. WATER METER IS SUPPLIED BY THE AUTHORITY.
7. EXTERIOR METER BOXES SHALL ONLY BE PERMITTED BY THE AUTHORITY WHEN THERE ARE NO ALTERNATIVES TO A PROTECTED INTERIOR METER. EXTERIOR METER PITS TO BE APPROVED BY THE AUTHORITY FOR DESIGN AND LOCATION.
8. INTERIOR METER LOCATION TO REMAIN ACCESSIBLE FOR SERVICING WITHOUT REMOVAL OF EQUIPMENT, STORAGE MATERIALS, PANELS, OR USE OF TOOLS.

SCHUYLKILL COUNTY MUNICIPAL AUTHORITY

WATER METER INSTALLATION

DRAWN BY: FSM

SCALE: NO SCALE

DATE: 9-03-09

DWG. NO.: 00124