




**90th % Lead Results = 0.001 mg/L  
(Action Level = 0.015 mg/L)**

**90th % Copper Results = 0.124 mg/L  
(Action Level = 1.3 mg/L)**

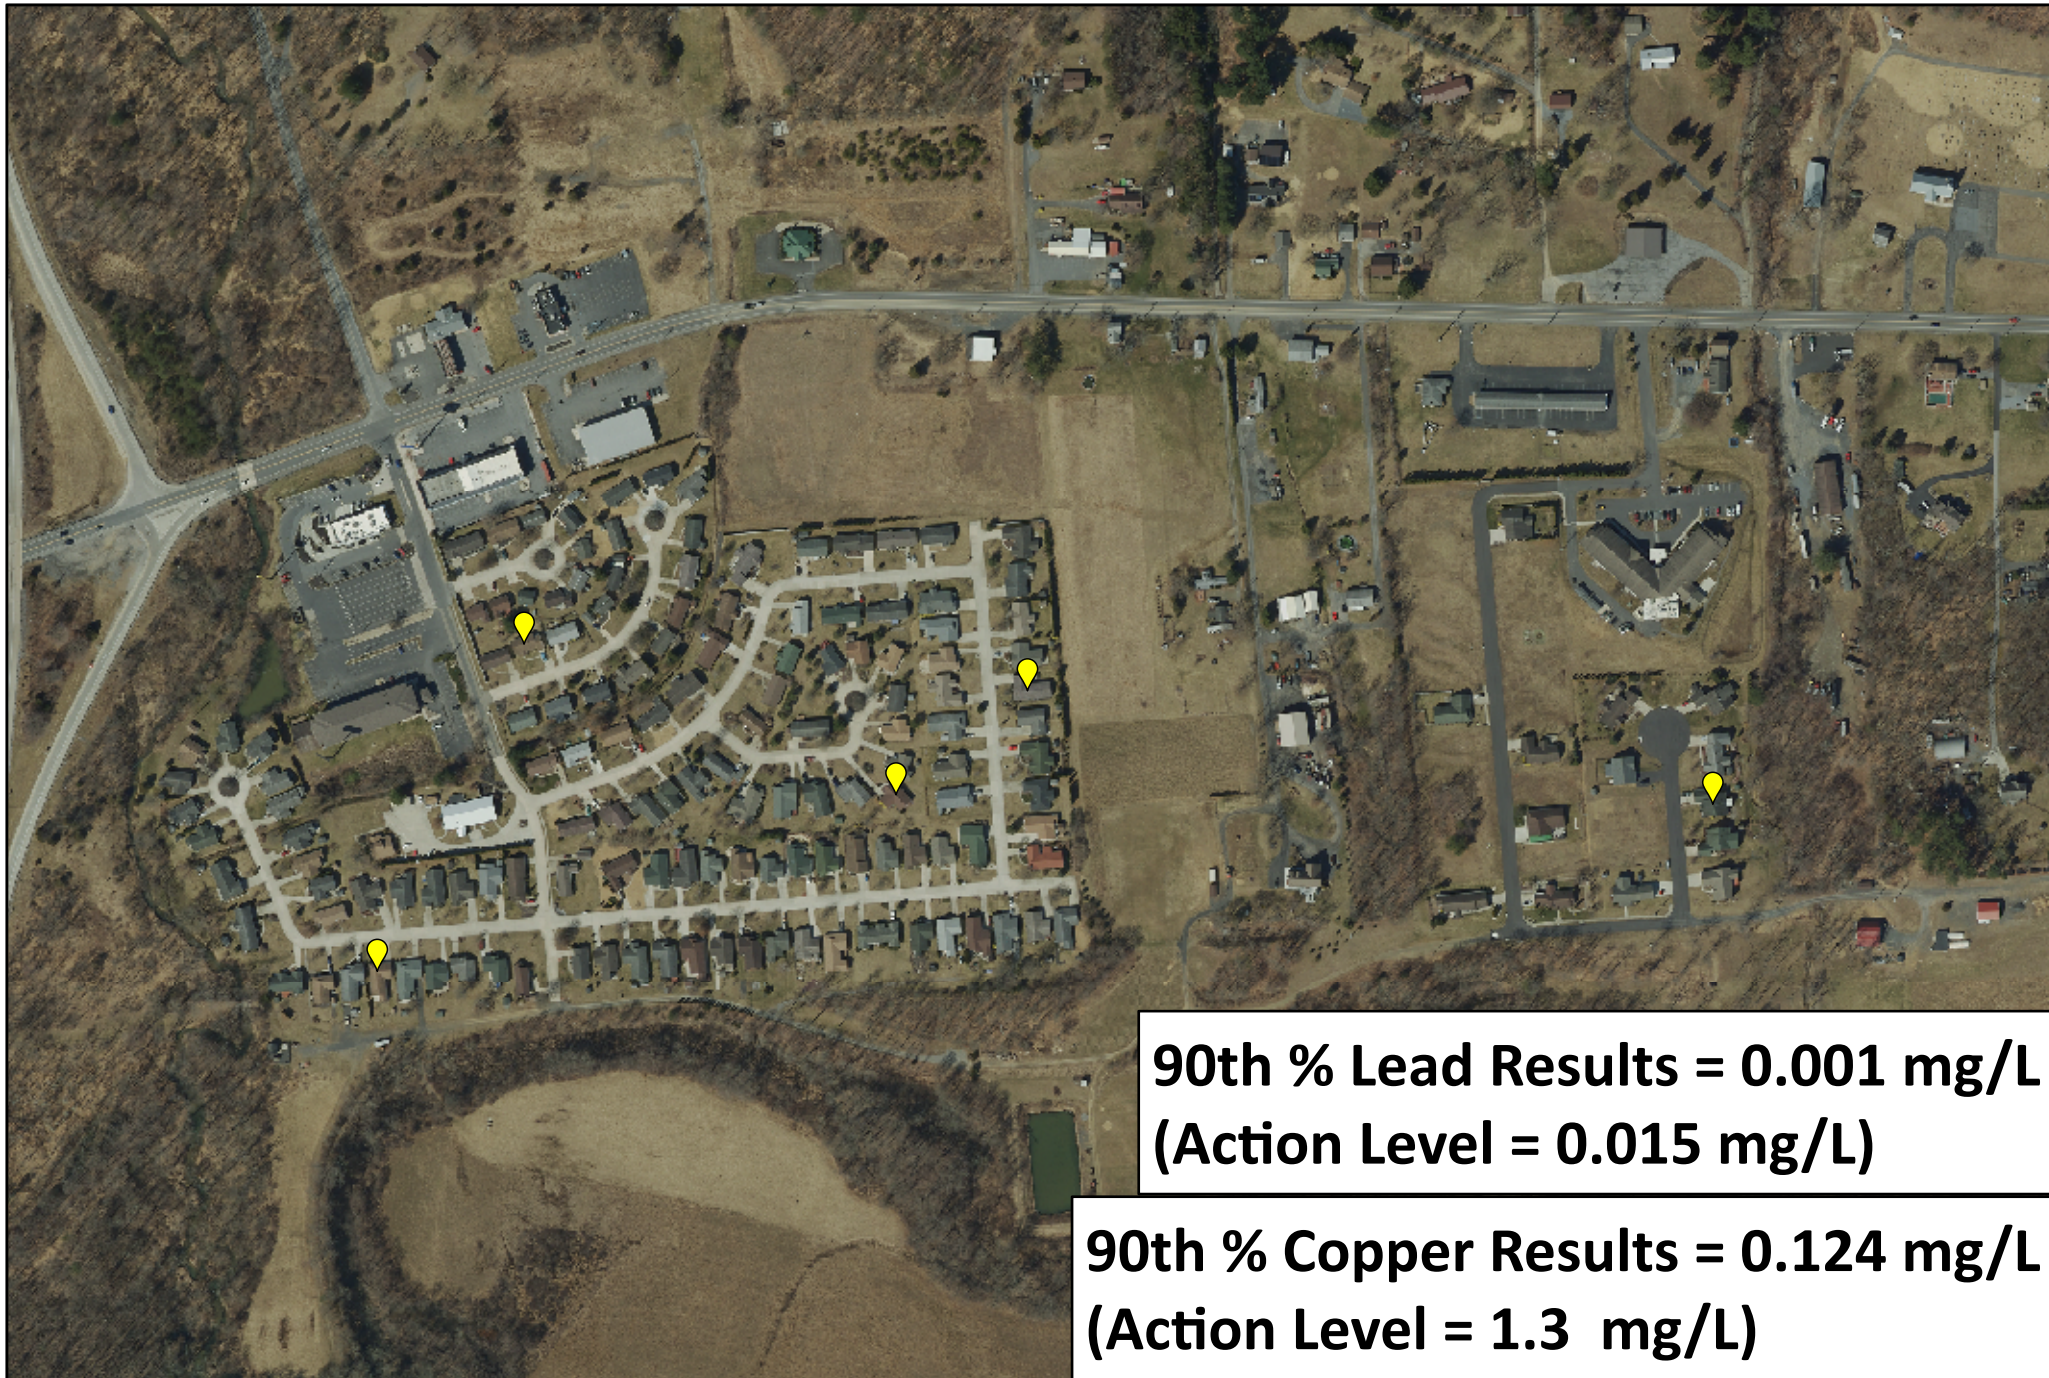

## Lead and Copper Sampling Locations Pine Grove Township

NAD 1983 StatePlane Pennsylvania South FIPS 3702 (US Feet)  
Lambert Conformal Conic

0 200 400 800 Feet

